


NOTES

1. Size of combination air release/air vacuum valve shall be specified in the Contract. Piping and valves shall be the same size as the combination air release/air vacuum valve.
2. Locate at the high point of the main, tap top of main.

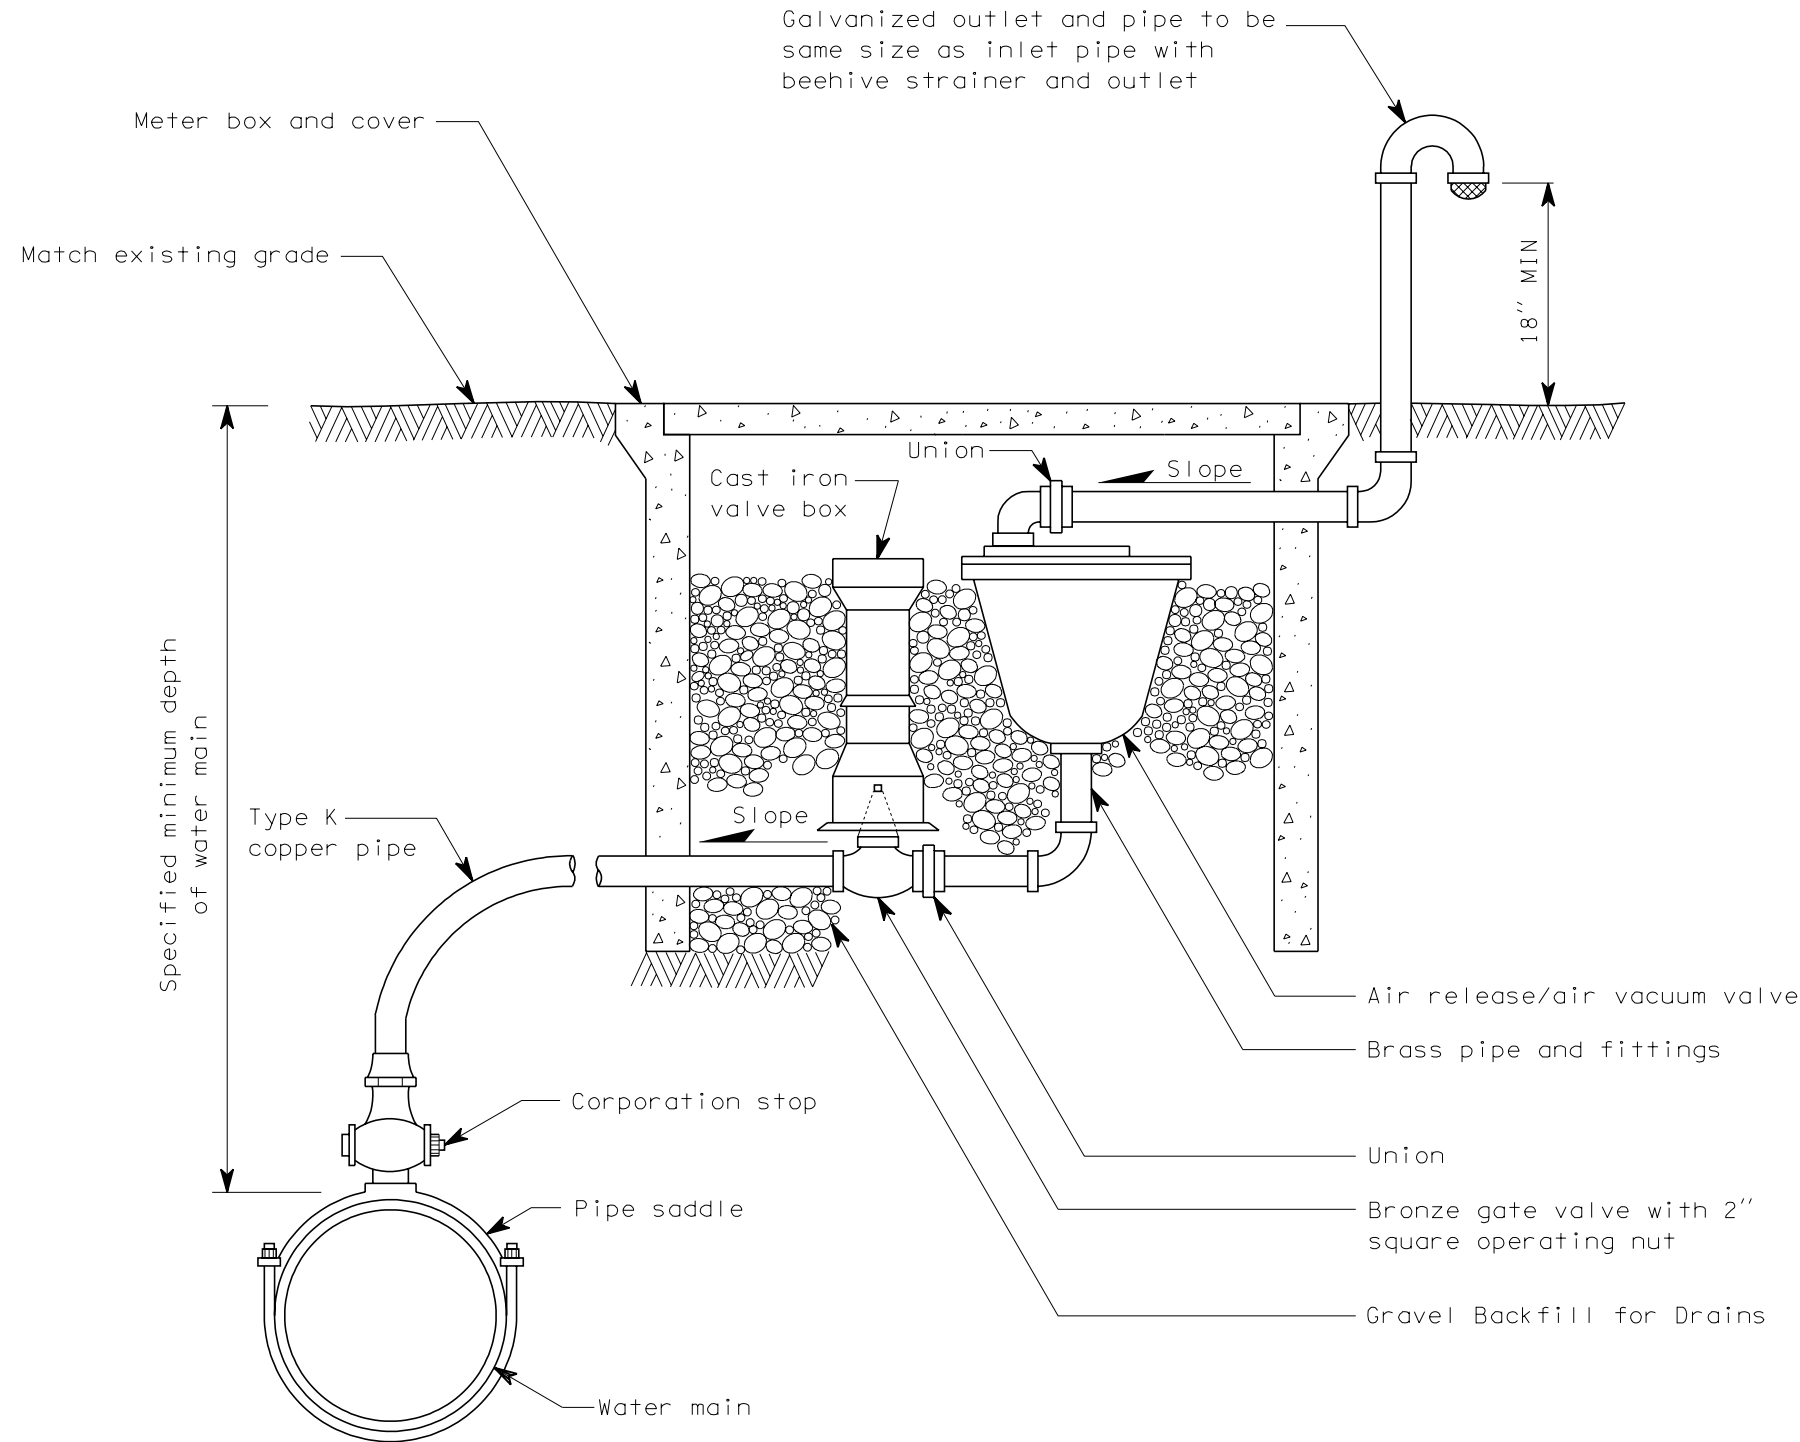

COMBINATION AIR RELEASE/
AIR VACUUM VALVE ASSEMBLY
STANDARD PLAN B-21a

NOTE: THIS PLAN IS NOT A LEGAL ENGINEERING DOCUMENT BUT AN ELECTRONIC DUPLICATE. THE ORIGINAL, SIGNED BY THE ENGINEER AND APPROVED FOR PUBLICATION, IS KEPT ON FILE AT THE WASHINGTON STATE DEPARTMENT OF TRANSPORTATION. A COPY MAY BE OBTAINED UPON REQUEST.			APPROVED FOR PUBLICATION	
8/98	DELETED NOTES 3 & 4	RAG	Clifford E. Mansfield	8/10/98
DATE	REVISION	BY	DEPUTY STATE DESIGN ENGINEER	DATE
			WASHINGTON STATE DEPARTMENT OF TRANSPORTATION	OLYMPIA, WASHINGTON